


Versuch 1-25  
 nach Umsetzung mit Benzoylchlorid  
 Versuchen Sie eine Interpretation der angekreuzten Peaks!

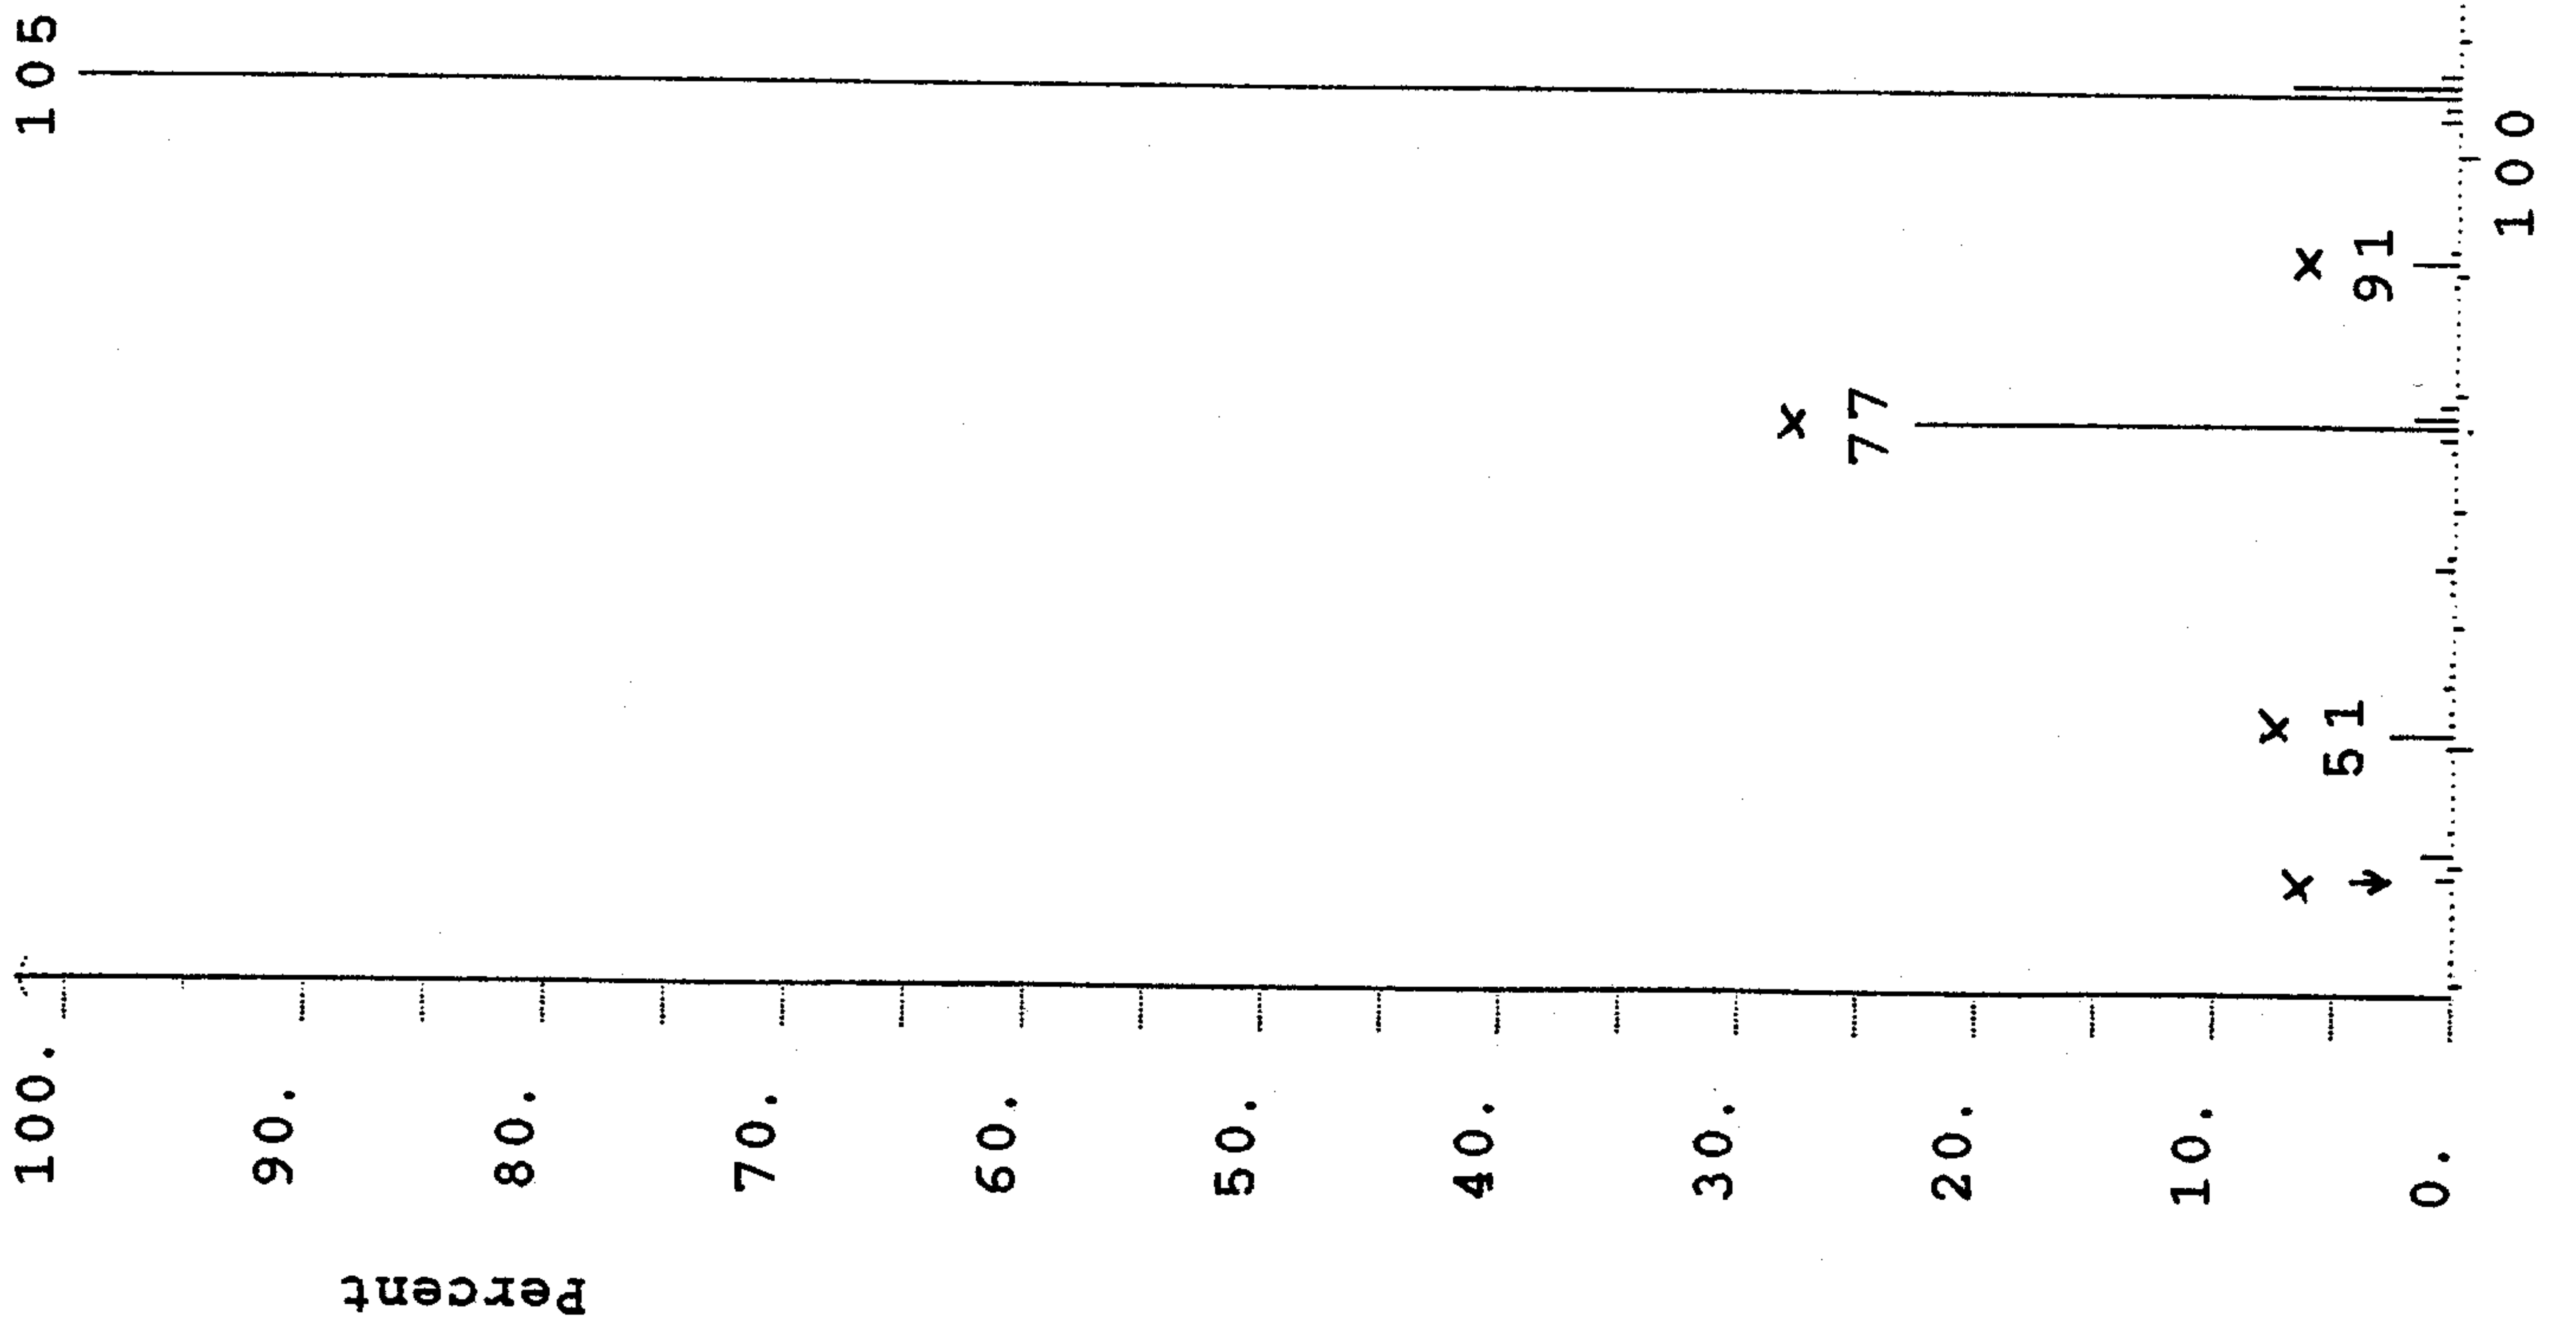

Mass	Rel.Inten. (%)
39.0	.75
41.0	1.39
50.0	.44
51.0	2.90
52.0	.35
53.0	.24
55.0	.50
65.0	.79
66.0	.25
76.0	.80
77.0	23.04
78.0	1.85
79.0	.68
91.0	1.99
92.0	.31
103.0	.86
104.0	.58
105.0	100.00
106.0	7.19
107.0	.84
115.0	.36
131.0	.31
163.0	.44
268.0	25.81
269.0	5.18
270.0	.63